


AWS Team 2023



Water Efficiency & Compliance Evaluation System

Daily monitoring of water flow rates by **WATER TREATMENT OPERATOR**

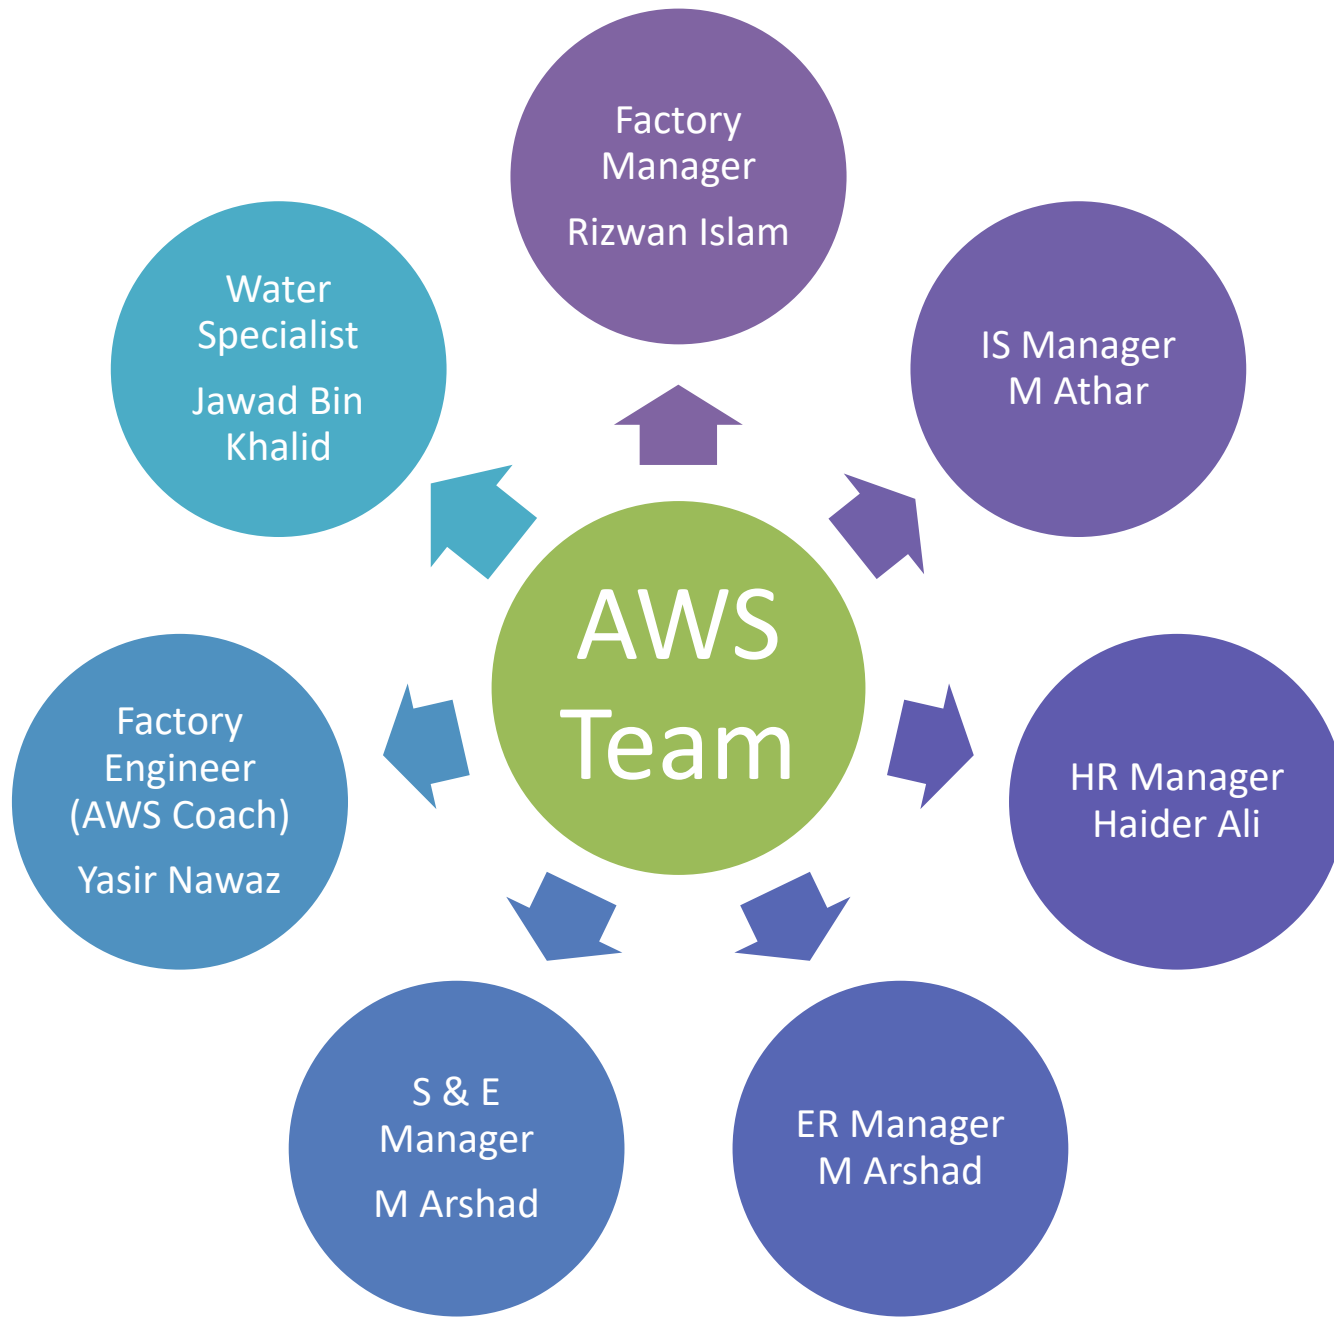

```
graph TD; A[Daily monitoring of water flow rates by WATER TREATMENT OPERATOR] --> B[Updating of daily monitoring water related data into Water Dashboard by WATER TREATMENT OPERATOR]; B --> C[Daily review of water related data by TEAM LEADER, PLANT MANAGEMENT]; C --> D[Monthly reporting of data to Factory Leadership team & Quarterly reporting of 3rd party reports (PEQs) to EPA team]; D --> E[Monthly reporting of data to Market – Head Of Technical];
```

Updating of daily monitoring water related data into Water Dashboard by **WATER TREATMENT OPERATOR**

Daily review of water related data by **TEAM LEADER, PLANT MANAGEMENT**

Monthly reporting of data to Factory Leadership team
& Quarterly reporting of 3rd party reports (PEQs) to EPA team

Monthly reporting of data to **Market – Head Of Technical**

Escalation Process

Escalation from Team to **Team Leader** through Shift Hand Over



Escalation from Team Leader to **PLANT MANAGER**



In case of further escalation requirement, Plant Manager escalates to **Factory Manager**



For further extended support, **HEAD OF TECHNICAL.**



Escalation to **MD and Zone**